

Outdoor Air Processing unit FDU-F

Model No. FDU650FKXZE1 FDU1100FKXZE1 FDU1800FKXZE1 FDU2400FKXZE1



Remote control (option)




RCN-KIT4-E2

(Option)


Air conditioning and intake of outdoor air are in the same system

Outdoor Air processing unit can be connected in a KXZ system as one of the indoor unit series and can create fresh and comfortable air supply together from our high advanced technology.

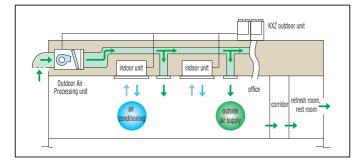

Compact design


Compact design at just 280(650, 1100), 379(1800, 2400)mm in height, high static pressure of 200Pa and the industry's lowest noise level can meet various kind of installation location for office, refresh room, restroom and kitchen of restaurant etc.

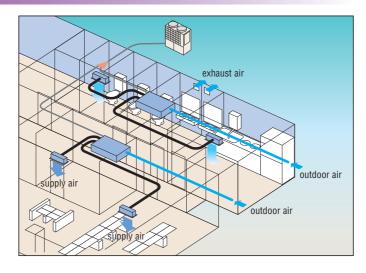

- (1) This unit is the specific unit for processing the outdoor air temperature closer to the room temperature. For conditioning the room temperature a
- dedicated air-conditioner is required additionally.
 (2) This unit monitors the outdoor air temperature and controls thermostat ON/OFF at the setting temperature by the remote controller, which indicates the outdoor air temperature for controlling thermostat ON/OFF. When thermostat is turned OFF, the operation is changed to the fan mode so that unprocessed outdoor air will be blown into the room directly. Therefore place the air outlet port or orient the air outlet direction not to blow air directly to persons in the room, especially in the small room such as a restroom and/or sanitary hot water supplying room.
- (3) It is strictly prohibited to monitor the room temperature by switching to the thermistor at remote controller side and/or the optional remote thermistor. Otherwise dew formation at air outlet port and/or dew dripping may occur during cooling operation due to the lower outdoor air temperature. Therefore keep the remote controller of this unit in place closer to the administrator so as not to be touched it freely by the end user (4) Dehumidifying operation with this unit is prohibited.
- (5) When handing over this unit to the end user, make sure to explain sufficiently about the foregoing cautions, the installation place and usage of remote control for this unit and the location of the air outlet

Motion sensor is equipped in the ceiling plane or wall plane and detects the presence/absence and activity of humans in a room to improve the comfort and energy saving performance of the unit.

Motion Sensor NEW






Connectivity with Outdoor units

FDU-F series are connectable to 8~60HP outdoor units, not connectable to 4~6HP, KXZ Lite.


Combination with Outdoor units

	case	Combination
		The total capacity of FDU-F is 50~100% of outdoor capacity and max quantity of FDU-F is 2 units.
В	In case both of OA processing units and dedicated air-conditioner are connected with outdoor units.	The total capacity of FDU-F and dedicated air-conditioners is 50~100% of outdoor capacity and max quantity of FDU-F should be below 30% of outdoor unit capacity.

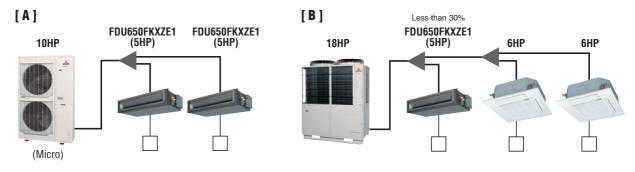

Concept (Difference between FDU-F and SAF)

SAF is the energy recovery ventilation unit which can recover heat energy from exhaust air to supply air and "has no air processing function, but FDU-F is air processing unit which can treat the supply air closer to room temperature by cooling or heating in connection with KXZ refrigerant system and exhaust air is discharged to outside of the room.

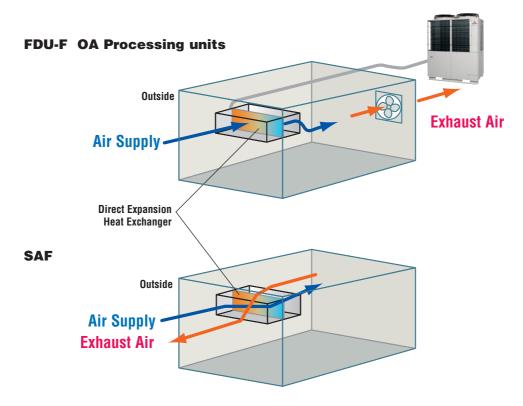



Specifications

Item M	/lodel	FDU650FKXZE1	FDU1100FKXZE1	FDU1800FKXZE1	FDU2400FKXZE1	
Nominal cooling capacity	kW	9.0	14.0	22.4	28.0	
Nominal heating capacity	kW	6.5	10.5	16.0	21.5	
Power source		1 Phase 220-240V, 50Hz				
Power Cooling	kW	0.24-0.25	0.35-0.36	1.16-1.20	1.16-1.20	
consumption Heating	KVV	0.24-0.25	0.35-0.36	1.16-1.20	1.16-1.20	
Sound pressure level	dB(A)	Hi:31	Hi:37	Hi:42	Hi:45	
Exterior dimension HxWxD	mm	280x950x635	280x1370x740	379x1600x893		
Net weight	kg	34	54	89	89	
Air flow (Standard)	m³/min	Hi:11	Hi:18	Hi:30	Hi:40	
External static pressure	Pa	200 (at Hi Air flow)				
Air filter, Q'ty		Procure locally				
Remote control(option)		wired:RC-EX3A, RC-E5, RCH-E3 wireless:RCN-KIT4-E2				
Installation data	Istallation data mm Liquid line:ø9.52(3/8")		Liquid line:ø9.52(3/8")	Liquid line:ø9.52(3/8")		
Refrigerating piping size	(in)	Gas line:ø15.88(5/8")		Gas line:ø19.05(3/4")	Gas line:ø22.22(7/8")	

1. The data are measured at 33°CDB 28°CWB (68%RH) during cooling and 0°CDB-2.9°CWB (50%RH) during heating (no frost). 2. Temperature range of outdoor air must be 20~40°CDB (32°CWB) during cooling and 0~24°CDB during heating.


3. Sound level indicates the value in an anechoic chamber. During operation these value are somewhat higher due to ambient conditions

4. The factory E.S.P. setting is set within the range of 10 - 120Pa.If SW8-4 is turned to "ON", E.S.P. setting range can be changed to 10 - 200 Pa. (with RC-EX3A and RC-E5 only)

Dimensions


All measurements in mm.


FDU650FKXZE1

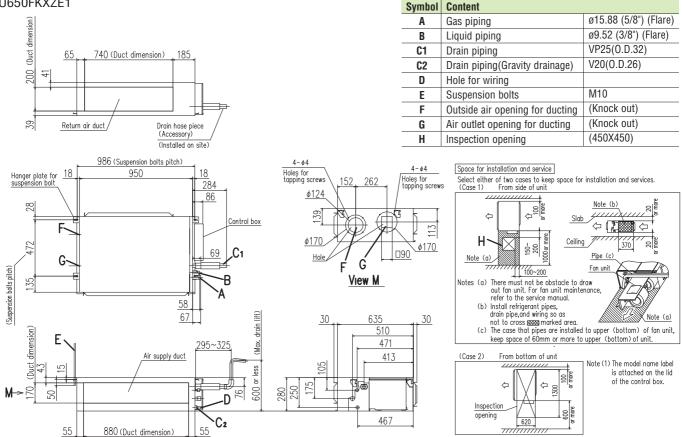




FDU1100FKXZE1




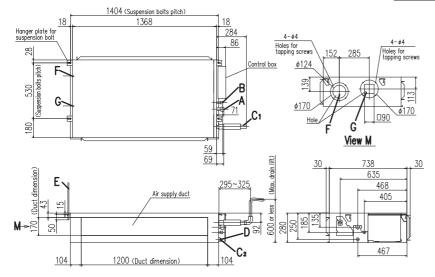



Space for installation and service Select either of two cases to keep space for installation and services (Case 1) From side of unit Note (b) or more ⇔ ¢ \$ Ceiling 20 H 150~ 200 370 1000 Pipe (c) Note (a) Fan unit 100~200 <u>1102200</u> There must not be obstacle to draw out 2 fan units. For fan units maint refer to the service manual. Install refrigerant pipes, drain pipe, and wiring so as not to cross **ESSS** marked area. (a) (b) Note (a) (c) The case that pipes are installed to upper (bottom) of fan unit, keep space of 60mm or more to upper (bottom) of unit. Se 2) From bottom of unit Note (Case 2) (1) The model name label or more is attached on the lid of the control box. ⇔ 1720 nspection 00 00 opening

FDU1800FKXZE1, FDU2400FKXZE1

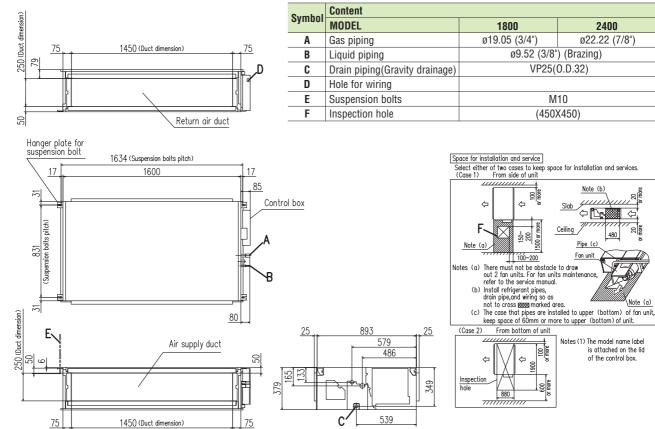

-	0	۱-
	U	,